


MOBILE HOME SERVICE TERMINATION DIRECT WIRED TYPE TO SERVICE PEDESTAL

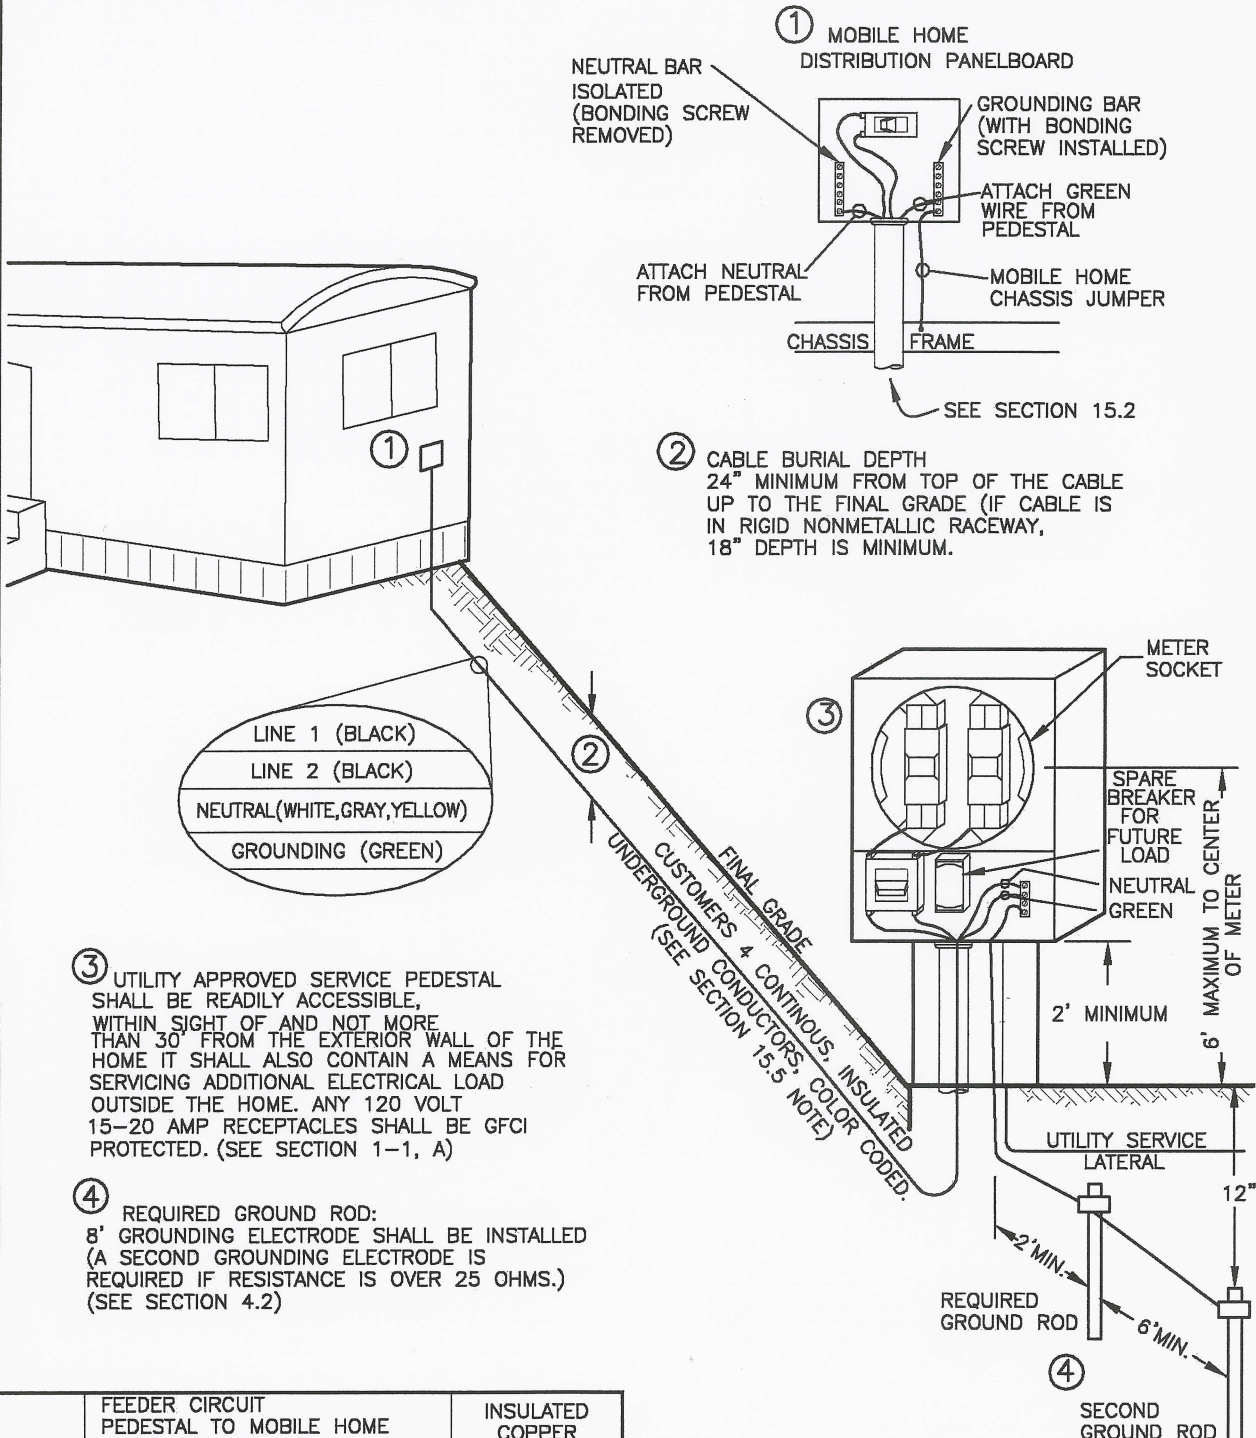

③ UTILITY APPROVED SERVICE PEDESTAL SHALL BE READILY ACCESSIBLE, WITHIN SIGHT OF AND NOT MORE THAN 30" FROM THE EXTERIOR WALL OF THE HOME IT SHALL ALSO CONTAIN A MEANS FOR SERVICING ADDITIONAL ELECTRICAL LOAD OUTSIDE THE HOME. ANY 120 VOLT 15-20 AMP RECEPTACLES SHALL BE GFCI PROTECTED. (SEE SECTION 1-1, A)

④ REQUIRED GROUND ROD:
8' GROUNDING ELECTRODE SHALL BE INSTALLED (A SECOND GROUNDING ELECTRODE IS REQUIRED IF RESISTANCE IS OVER 25 OHMS.) (SEE SECTION 4.2)

- LINE 1 (BLACK)
- LINE 2 (BLACK)
- NEUTRAL (WHITE, GRAY, YELLOW)
- GROUNDING (GREEN)

AMPS	FEEDER CIRCUIT PEDESTAL TO MOBILE HOME				INSULATED COPPER GROUNDING WIRE (GREEN)
	CONDUCTOR COPPER	RHW, UF, URD, OR CONDUIT	ALUM	EQUIV. CONDUIT	
100	#4	1 1/4"	#2	1 1/4"	#8
150	#1	1 1/2"	#2/0	1 1/2"	#6
200	#2/0	2"	#4/0	2"	#6

Diagram 15-C